

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106


1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400

TEST REPORT

Client : Quest Flooring Pty Ltd
43-55 Mark Anthony Drive
Dandenong South VIC 3175

Test Number : 24-002216
Issue Date : 27/06/2024
Print Date : 27/06/2024

Sample Description Clients Ref : "Bystander"
Twist pile carpet
Colour : Grey
End Use : Flooring
Nominal Composition : Solution Dyed Polyester
Nominal Mass per Unit Area/Density : 1360g/m2
Nominal Thickness : 10mm

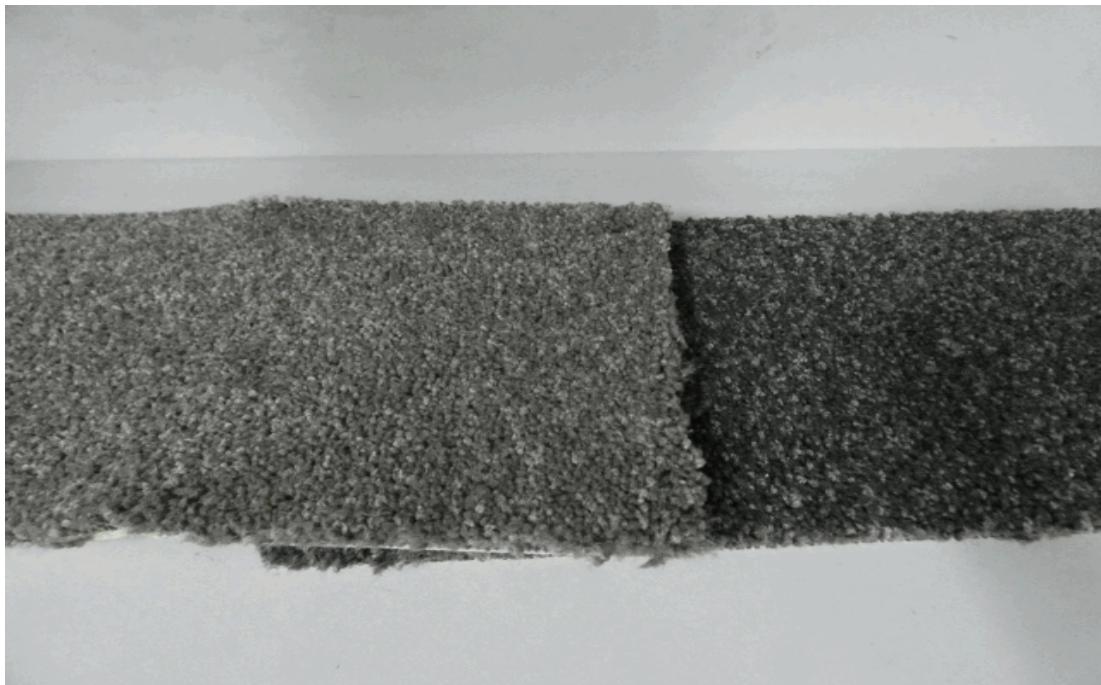

324719

71276

Page 1 of 2

© Australian Wool Testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



Fiona McDonald

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400

TEST REPORT

Client : Quest Flooring Pty Ltd
43-55 Mark Anthony Drive
Dandenong South VIC 3175

Test Number : 24-002216
Issue Date : 27/06/2024
Print Date : 27/06/2024

AS 4586-2013 Appendix A

Slip Resistance Classification of New Pedestrian Surface Materials Dry Pendulum Test Method

Date of Testing 27-06-2024
Operator AWTA Test Operator 4
Test Temperature 21 °C
Sample tested as received, no underlay
Pile Direction Length
Fixed/Unfixed Unfixed
Slider No 96 Batch No 23

| Length | 1 | 2 | 3 | 4 | 5 | SRV |
|-------------------------|----|----|----|----|----|-----|
| British Pendulum Number | 65 | 63 | 63 | 65 | 60 | 63 |

Classification (Surface tested dry) P5

Equipment: Cooper Pendulum Skid Tester Serial No: 1433-01 Calibrated 11/10/2023
Slider prepared using P400 and 3µm lapping film.

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance and wear on their slip resistance be checked.

324719

71276

Page 2 of 2

© Australian Wool Testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



Fiona McDonald

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR